A0 - Do not scale

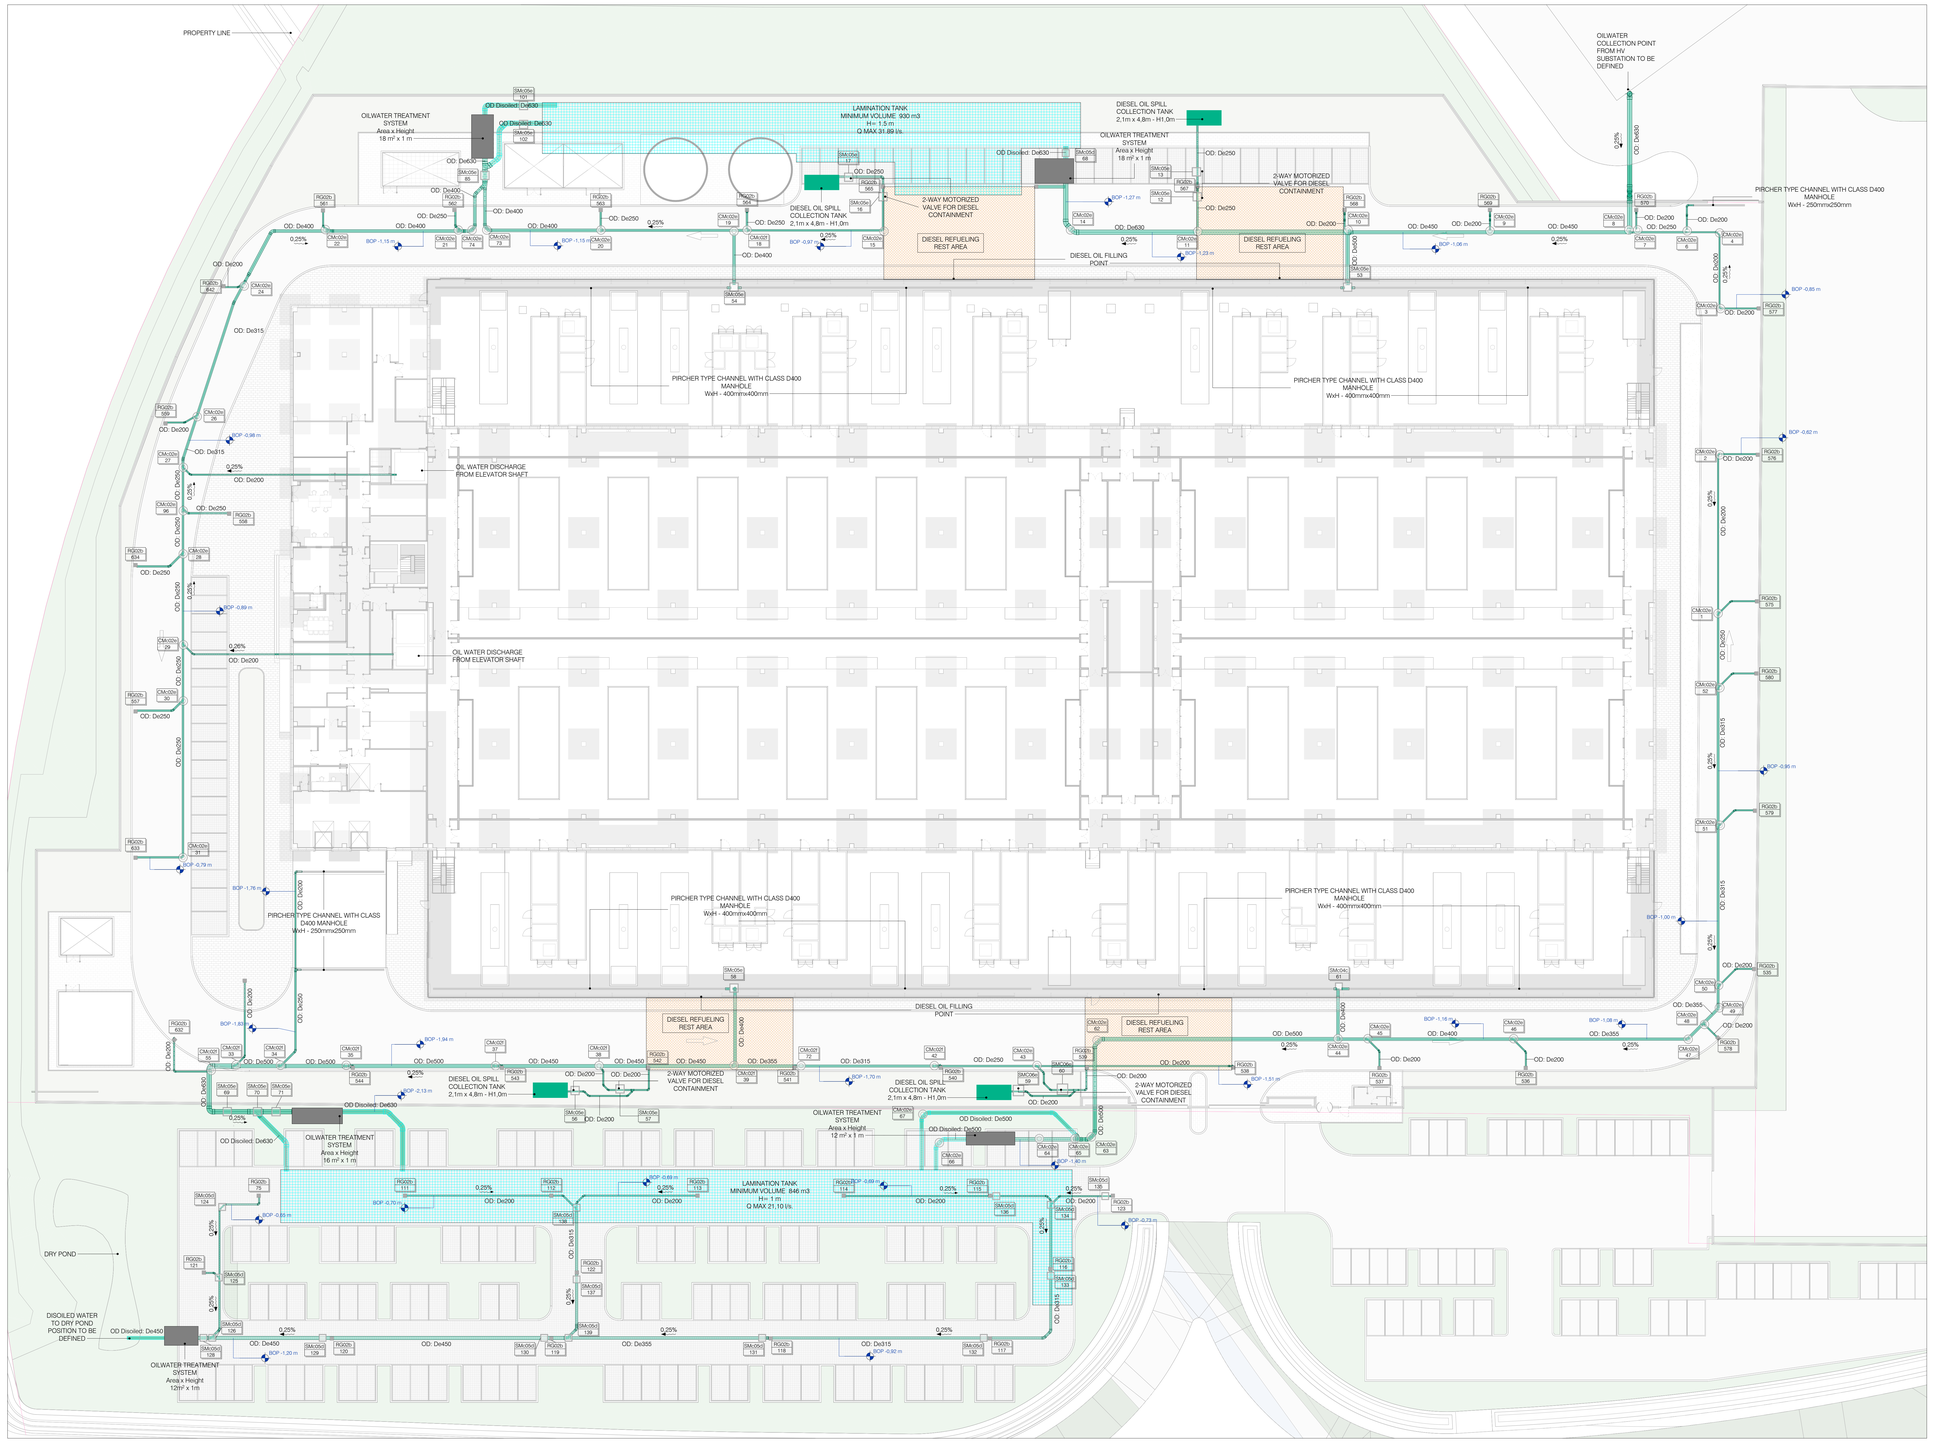


Oilwater Drainage System
1 : 250

## DR - Pipe Systems Legend

| | |
|---|---|
| OD | Oil water |
| OD Disoiled | Disoiled water |
| BOP | Bottom of Pipe's Quote |

NOTES PLUMBING AND DRAINAGE SYSTEMS:

- Supply piping for the water and sanitary utilities within the toilets will be made of multilayer from manifolds.
- In case of supply not derived from manifold, place recessed shut-off taps with cap for each water utility.
- Provide vents at high points and drains (connected to prepared manholes or conduits) at low points, in locations agreed with the DL.
- All drain risers should be equipped with inspectable siphon at the foot, extended above the roof and adequately ventilated.
- Condensate water collection networks must be separate and distinct from those into which they flow by the interception of permanently wet or dry inspectable odor trap.
- Rainwater collection networks must be separate and distinct from those into which they flow by the interception of a siphon with inspection chamber.
- Stormwater collection networks shall be separate and distinct from blackwater to the collection sumps located upstream of the Inspection/Siphon/Basin unit feeding to the public sewer.
- All discharges collected below the level of discharge to the public sewer shall be conveyed to collection and lifting tanks equipped with electric pumps.
- Testing operations should be carried out while keeping the drainage network continuously visible.
- Provide inspection points in manifolds upstream of each confluence, bend or special piece.
- All drainage pipes, primary, secondary, except where otherwise indicated, shall have the following minimum slopes:
  - service drains to sewer risers: i=2%
  - blackwater / grease collectors: i>=1%
  - stormwater / condensate manifolds: i>=0,5%.




GENERAL NOTES:

- Drawing valid only for mechanical installations under contract.
- Any discrepancies between technical materials and equipment are to be verified on site by the contractor, who shall promptly report any interference with existing.
- Any undetected equipment shall be maintained, if necessary, it shall be modified and relocated by the contractor.
- Exact locations of equipment, materials, piping, ducts, connection to existing facilities shall be determined by the contractor and submitted to the construction manager.
- All equipment must be easily maintainable and accessible via trapdoors or similar solutions even where not specifically specified.
- All equipment must be easily maintainable and accessible via trapdoors or similar solutions even where not specifically specified.
- It will be the contractor's responsibility to size and assevarate all supports, in a workmanlike manner and in compliance with all regulatory requirements for earthquake-proofing.
- Construction detail drawings necessary for the proper execution of the work shall be arranged by the contractor.
- The installation of elements in the field must comply with all manufacturers' prescriptions and recommendations, good engineering rules on acoustics and fire prevention.
- The sizing of the plant components, evaluated on the bases of the available documentation, should be re-evaluated and deepened during the works, after plant verification following appropriate surveys of the existing situation.
- The contractor must carefully check the design and report any inaccuracies, incompleteness or discrepancies with any standard or law.
- Connections between two or more sections of duct both with indoor units and with ducts themselves, shall be made only with invitation fittings and not with hammered derivations or detachments. The Contractor shall be responsible for making construction drawings showing the type of derivations and connections between ducts and ducts with the indoor units provided.

### S300_Plumbing Fixture Legend

| Keynote_Mirror | Type_L000H or De-H |
|---|---|
| CMx02e | L22_PLM_CM_Circular Manhole with closed bottom De1200H1500 |
| CMx02e | L22_PLM_CM_Circular Manhole with closed bottom De1200H2000 |
| CMx02f | L22_PLM_CM_Circular Manhole with closed bottom De1200H2500 |
| SMx04c | L22_PLM_SM_Square Manhole with closed bottom 1000X1000H1000 |
| SMx05d | L22_PLM_SM_Square Manhole with closed bottom 1000X1000H1500 |
| SMx05e | L22_PLM_SM_Square Manhole with closed bottom 1300X1300H2000 |
| SMx06e | L22_PLM_SM_Square Manhole with closed bottom 1500X1500H2000 |

### Manhole - Tag

Object code (Keynote_Mirror) → PXXX
Height → XXJ, YYY → Progressive Number

Object code (Keynote_Mirror) → DXXX
Progressive Number → DXXX

General Notes

1. This drawing has been checked in accordance with Black & White Engineering (B&W) Quality Procedures.
2. Do not scale from this drawing. All dimensions indicated are in millimeters unless otherwise stated. Validate all measurements on site.
3. Unless specifically indicated, equipment layout. The Contractor should show actual, approved plant and equipment sizes.
4. This drawing is to be read in conjunction with all relevant B&W MEP specifications, schedules and standard key to symbols sheet.
5. Any discrepancies between the drawings and other documents should be brought to the attention of the Contractor.
6. This drawing is not an installation drawing. It is the Contractors responsibility to make final coordinated installation shop drawings.
7. Contractor to coordinate with other trades in the design package.
8. Contractor to coordinate that distribution routes with available sleeves and openings in beams / structure.
9. The contents of this drawing shall be read in conjunction with the current revisions of other relevant Architectural, Structural, Mechanical and Electrical drawings and all relevant sections of the specifications.

1000 0 1000 2000 3000 4000
SCALE: 1:100

Key Plan



The Level Key Plan shows the levels used for the design. The system dimensions refer to the Level 00 -FLL. All pipe base heights refer to absolute height as distance from level

| Rev | Details | By / Chkd / App | Date |
|---|---|---|---|
| P02 | STAGE 3 - 100% ISSUE | LGA/GLE/MAC | 17/01/2025 |
| P02 | STAGE 3 - 60% ISSUE | LGA/GLE/MAC | 26/11/2024 |
| P01 | STAGE 2 - ISSUED FOR APPROVAL | LGA/GLE/MAC | 11/10/2024 |

Client
STACK INFRASTRUCTURE

Lead Consultant / MEP Designer
Office No. 1801
Marina Plaza
Dubai marina
Dubai, United Arab Emirates
Tel: +971 4 369 2228
www.bw-engineering.com

Designer / Architect / Civil
L22 s.r.l. una divisione di Lombardini22 S.p.A.
Via Lombardini 22
20143 Milano, Italia
T +39 02 89 30 00 00
info@l22.it
20143 Milano, Italia
T +39 02 89 30 13 97
www.l22.it

Structural
Studio Progetti Strutturali
Ing. Arturo Donadio
S.P.S. S.r.l.
Via M. Gioia, 64 - 20125 Milano, Italia
segreteria@spsarch.eu T. 0258006857
www.spsarch.eu

Project Title
Data Center Stack Campus Siziano (PV)

Drawing Title
Planimetria gestione acque oleose MIL08A

Designer
Ing. Roberto Cereda
iscritto all'Ordine degli Ing. di Brescia n. 2609

Project Status
VIA (Titolo III, d.lgs. 152/2006)

Discipline | Status Code

Project Number: ME-0003
Scale @ A0: 1:250
Revision: 30/06/2026

Drawing Number
4553-L22-ZZ-ZZZ-TRP-DRW-ME-0003